




BASIN WITH CURB INLET

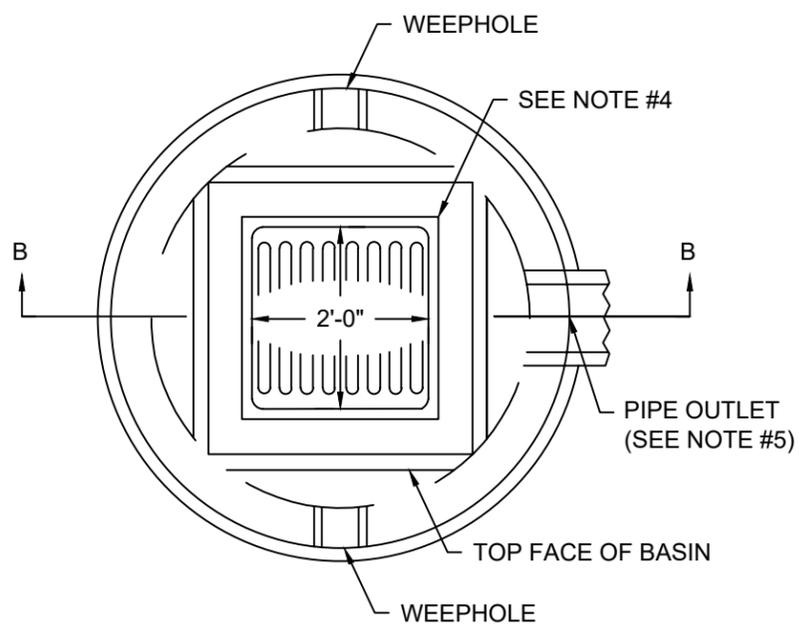

BASIN WITH 4 FLANGE INLET

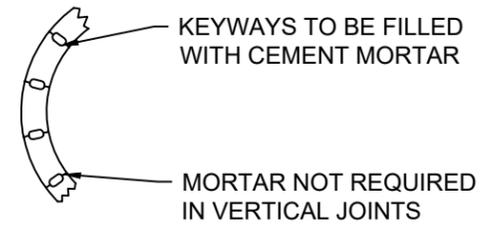

SECTION C-C

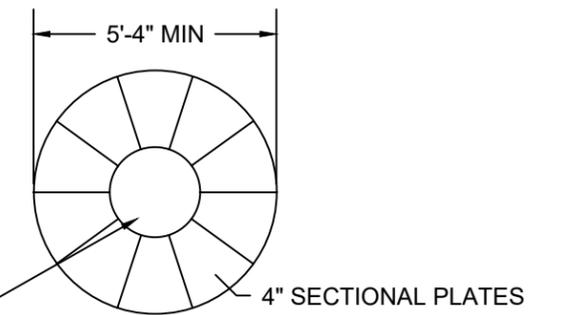


SOLID SECTION, OR FILL HOLE WITH BRICKS AND MORTAR, OR FILL WITH 4000 PSI CEMENT CONCRETE (SEE MASSDOT SPECIFICATIONS FOR DESIGN REQUIREMENTS) (IF CONCRETE IS HAND MIXED SEE LATEST SPECIFICATIONS)

PLAN OF BASE


\* MINIMUM DEPTH OF SUMP TO BE 4'-0"

NOTES:

1. WEEPHOLES SHALL BE 4" PIPE OPENING OR EQUIVALENT WITH 1/4" MESH, 23 GAGE GALVANIZED WIRE SCREEN COVERING, 2 CUBIC FEET OF CRUSHED STONE SHALL BE PLACED AROUND EACH WEEPHOLE.
2. BRICKS MAY BE USED BETWEEN TOP COURSES AND C.B. FRAME FOR GRADE ADJUSTMENT. FRAME SHALL SET IN FULL BED OF MORTAR.
3. FOR DESCRIPTION, MATERIALS, AND CONSTRUCTION METHODS, SEE STANDARD SPECIFICATIONS.
4. DETAILS SHOWN ON DRAWINGS 222.0.1 - 222.2.1
5. FACE OF PIPE FLUSH OR NOT TO PROJECT MORE THAN 4" FROM FACE OF WALL ALONG CENTERLINE OF PIPE

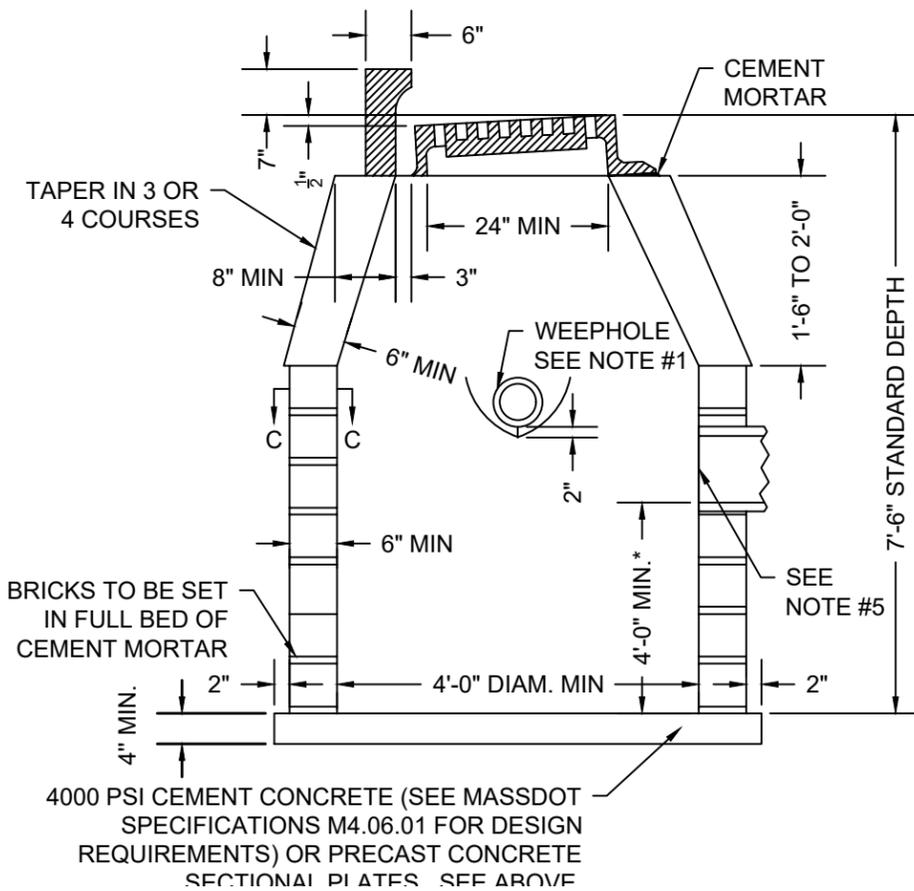

SECTION A-A

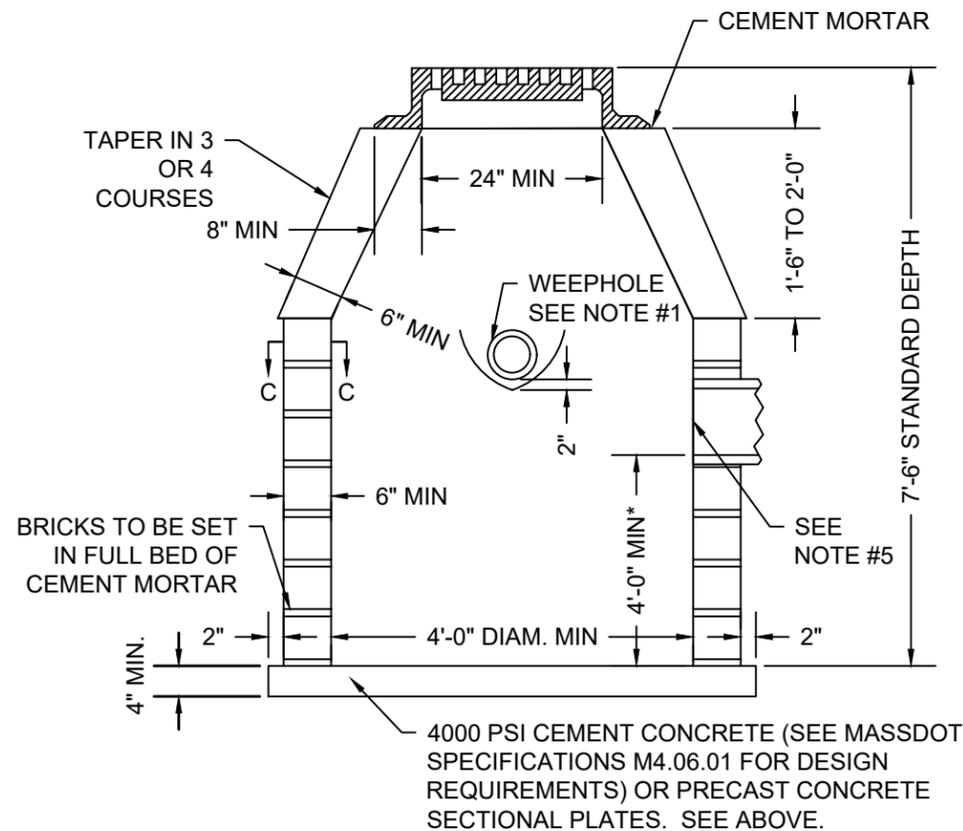

SECTION B-B