

**SECTION A-A**


4000 PSI CEMENT CONCRETE (SEE MASSDOT SPECIFICATIONS M4.06.1 FOR DESIGN REQUIREMENTS) OR PRECAST CONCRETE SECTIONAL PLATES SEE DRAWING 202.0.1

BRICKS MAY BE USED BETWEEN FRAME AND TOP COURSE FOR GRADE ADJUSTMENT. FRAME TO BE SET IN FULL BED OF MORTAR.

FACE OF PIPE FLUSH OR NOT TO PROJECT MORE THAN 4" FROM FACE OF WALL ALONG CENTERLINE OF PIPE.

\*MIN. DEPTH TO BE 4'-0"

- NOTES:**
1. MINIMUM CAST IRON FRAME MASS - 205 LBS. SEE DETAIL ON DRAWING 206.0.1
  2. STANDARD PARALLEL BAR GRATE TO BE USED. SEE DETAILS ON DRAWINGS ON DRAWINGS 222.2.1
  3. FOR DESCRIPTION, MATERIALS, AND CONSTRUCTION METHODS, SEE STANDARD SPECIFICATIONS
  4. THIS DROP INLET IS NOT BE USED AT ANY LOCATION WHERE IT MAY PRESENT A HAZARD TO VEHICLES THAT RUN OFF THE ROAD FOR FLUSH TYPE SEE DRAWING 208.1.1
  5. SEE DRAWING 201.0.1 CONCRETE BLOCK CATCH BASIN FOR DETAILS

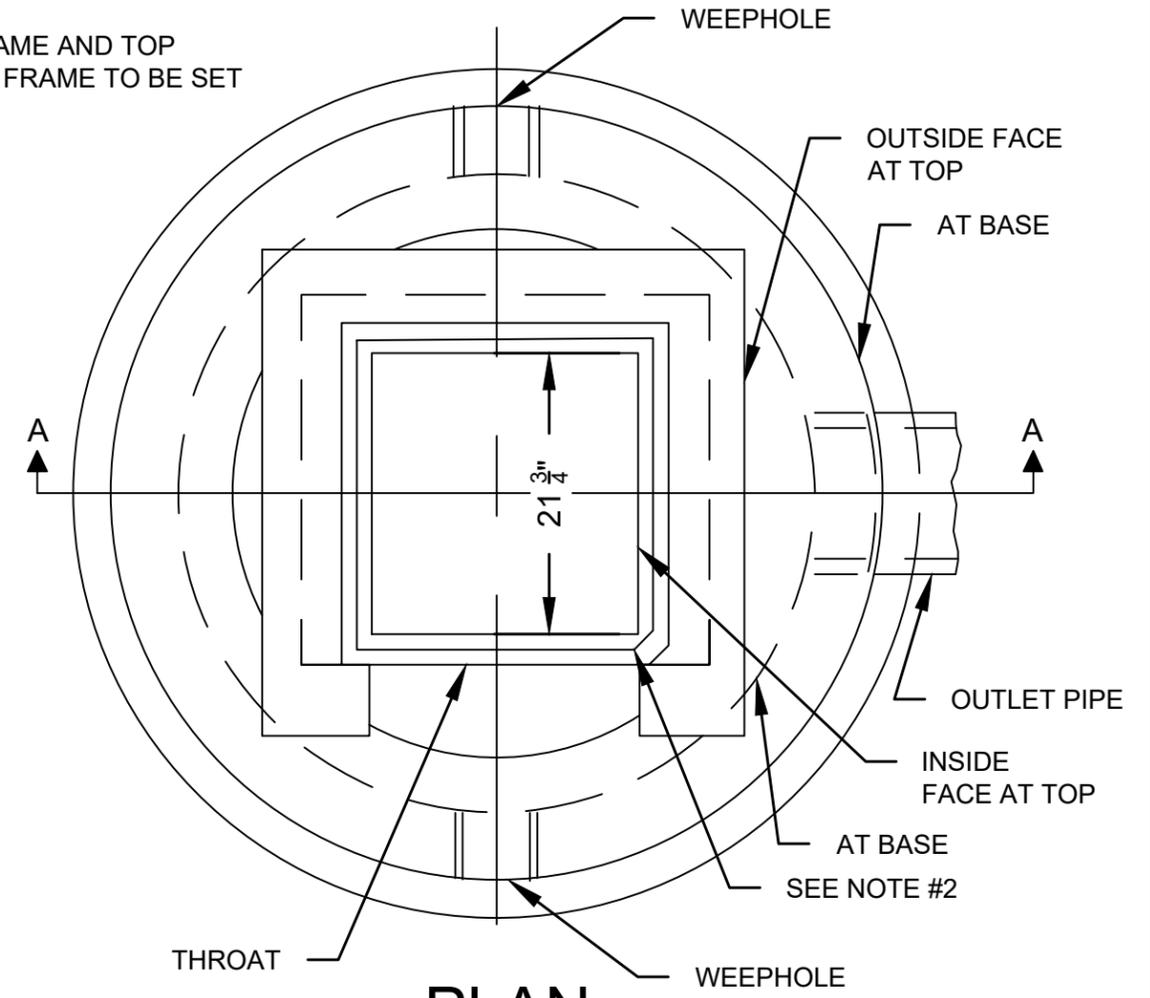

**PLAN**