



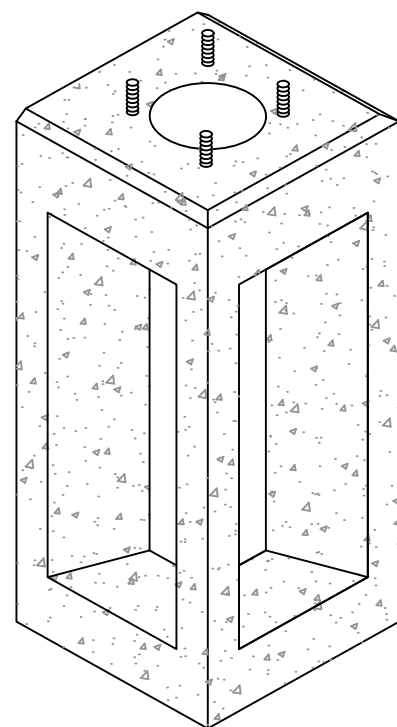


ISOMETRIC VIEW

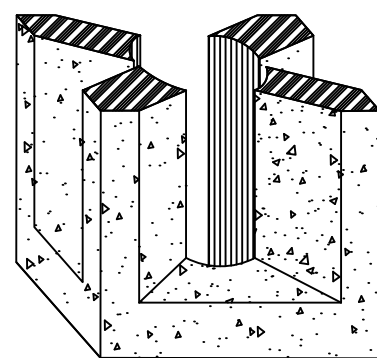


PICTORIAL VIEW
(SECTION A-A)

NOTES:

1. PRECAST CONCRETE PER M4.09.0.
2. HORIZONTAL AND VERTICAL #4 REINFORCING BARS SHALL BE EITHER EPOXY COATED PER M8.01.7 OR GALVANIZED PER M8.01.8. ALL REINFORCING BARS SHALL HAVE 1 3/4 IN. (MIN.) OF COVER.
3. FABRICATOR SHALL SUPPLY NUTS AND 3-IN. WASHERS FOR EACH ANCHOR BOLT.
4. FABRICATOR MAY ADD LOOPS OR ANCHORS TO ASSIST WITH LIFTING AND TRANSPORTATION AS LONG AS THEY ARE LOCATED A MINIMUM OF 9 IN. BELOW THE TOP OF THE FOUNDATION AND DO NOT AFFECT THE INTEGRITY OF THE REINFORCING BARS OR ANCHOR BOLTS.

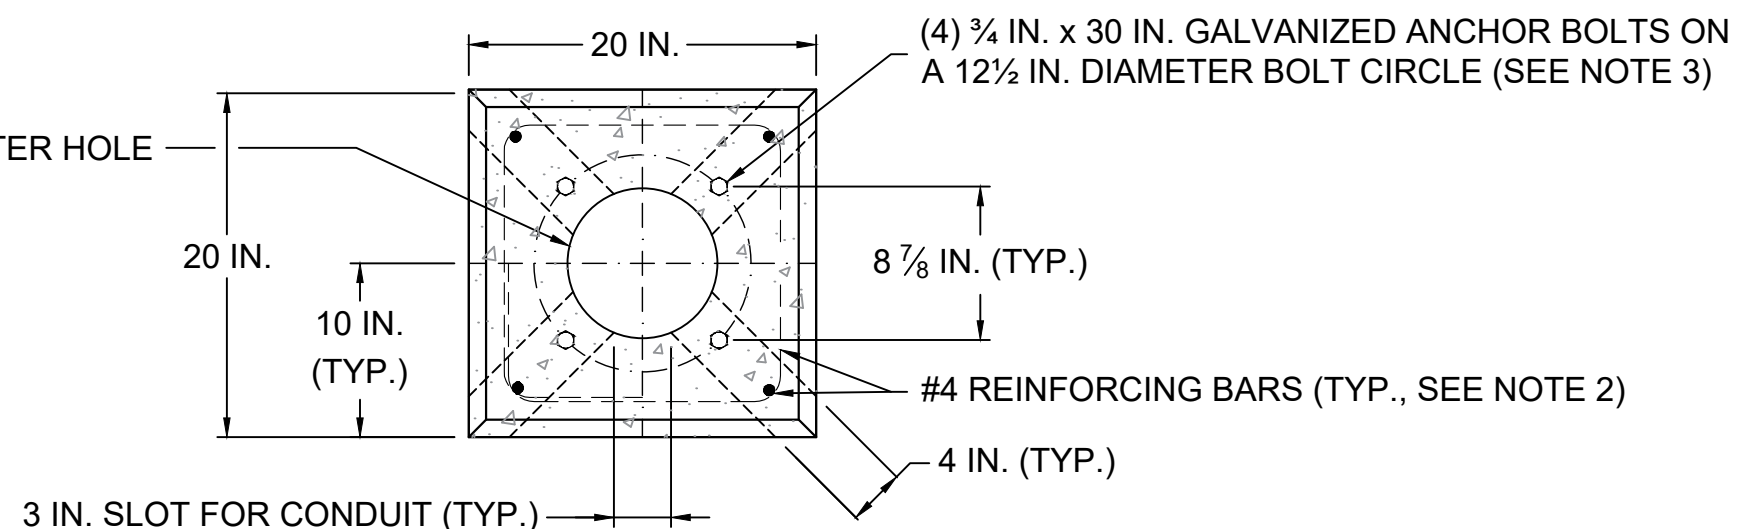

PLAN VIEW

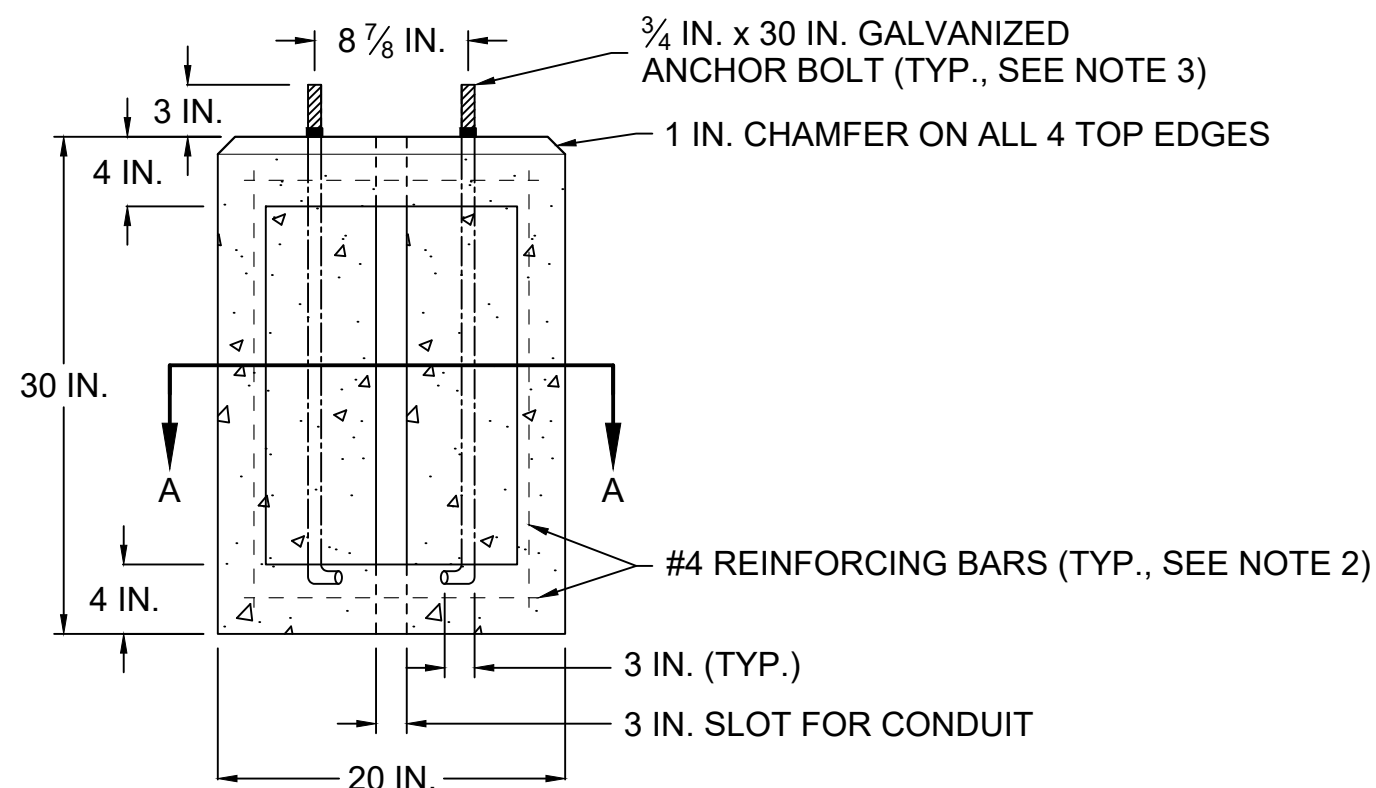

ELEVATION VIEW