



NOTES:

1. PRE-FORMED JOINT FILLER MEETING M9.14.0 SHALL BE PLACED ADJACENT TO THE CONCRETE FOUNDATION TO FORM AN ISOLATION JOINT WITH THE ADJOINING CURBING OR SIDEWALK.
2. THE LOAD CENTER ENCLOSURE SHALL BE A LOCKABLE CABINET CONTAINING THE REQUIRED CIRCUIT BREAKERS. THE ENCLOSURE SHALL BE POSITIONED TO MEET ALL ADA/AAB CLEARANCE REQUIREMENTS.
3. THE LOAD CENTER ENCLOSURE SHALL BE INSTALLED DIRECTLY BELOW THE METER PANEL.
4. THE LOAD CENTER ENCLOSURE AND METER PANEL SHALL BE INSTALLED FACING AWAY FROM TRAFFIC.

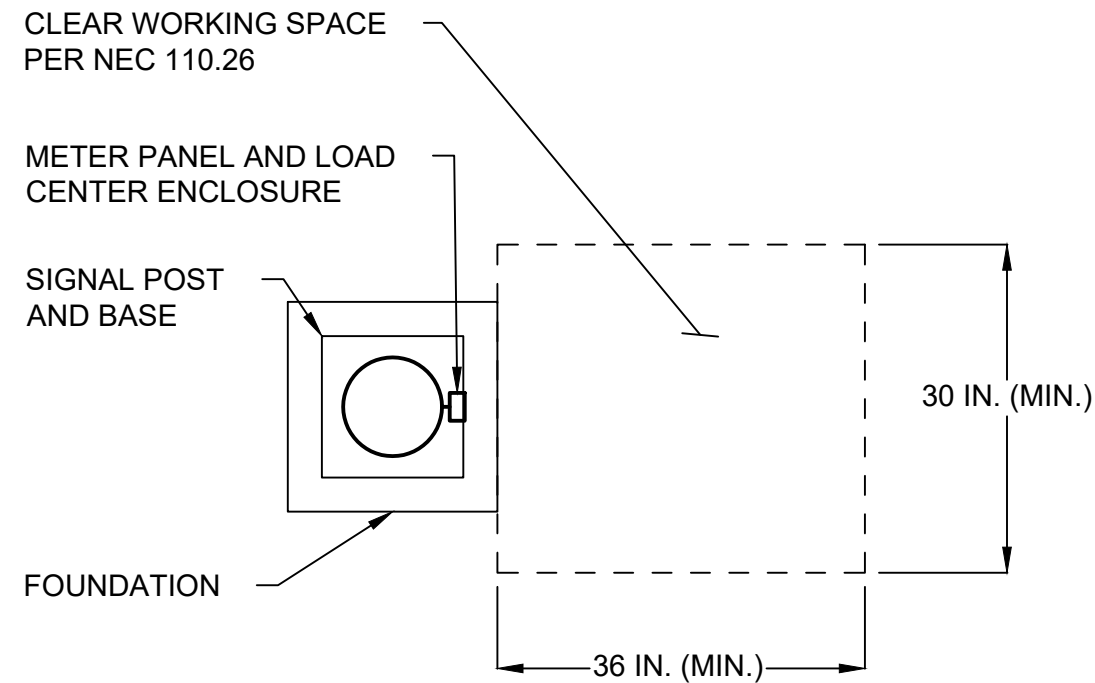

PLAN VIEW

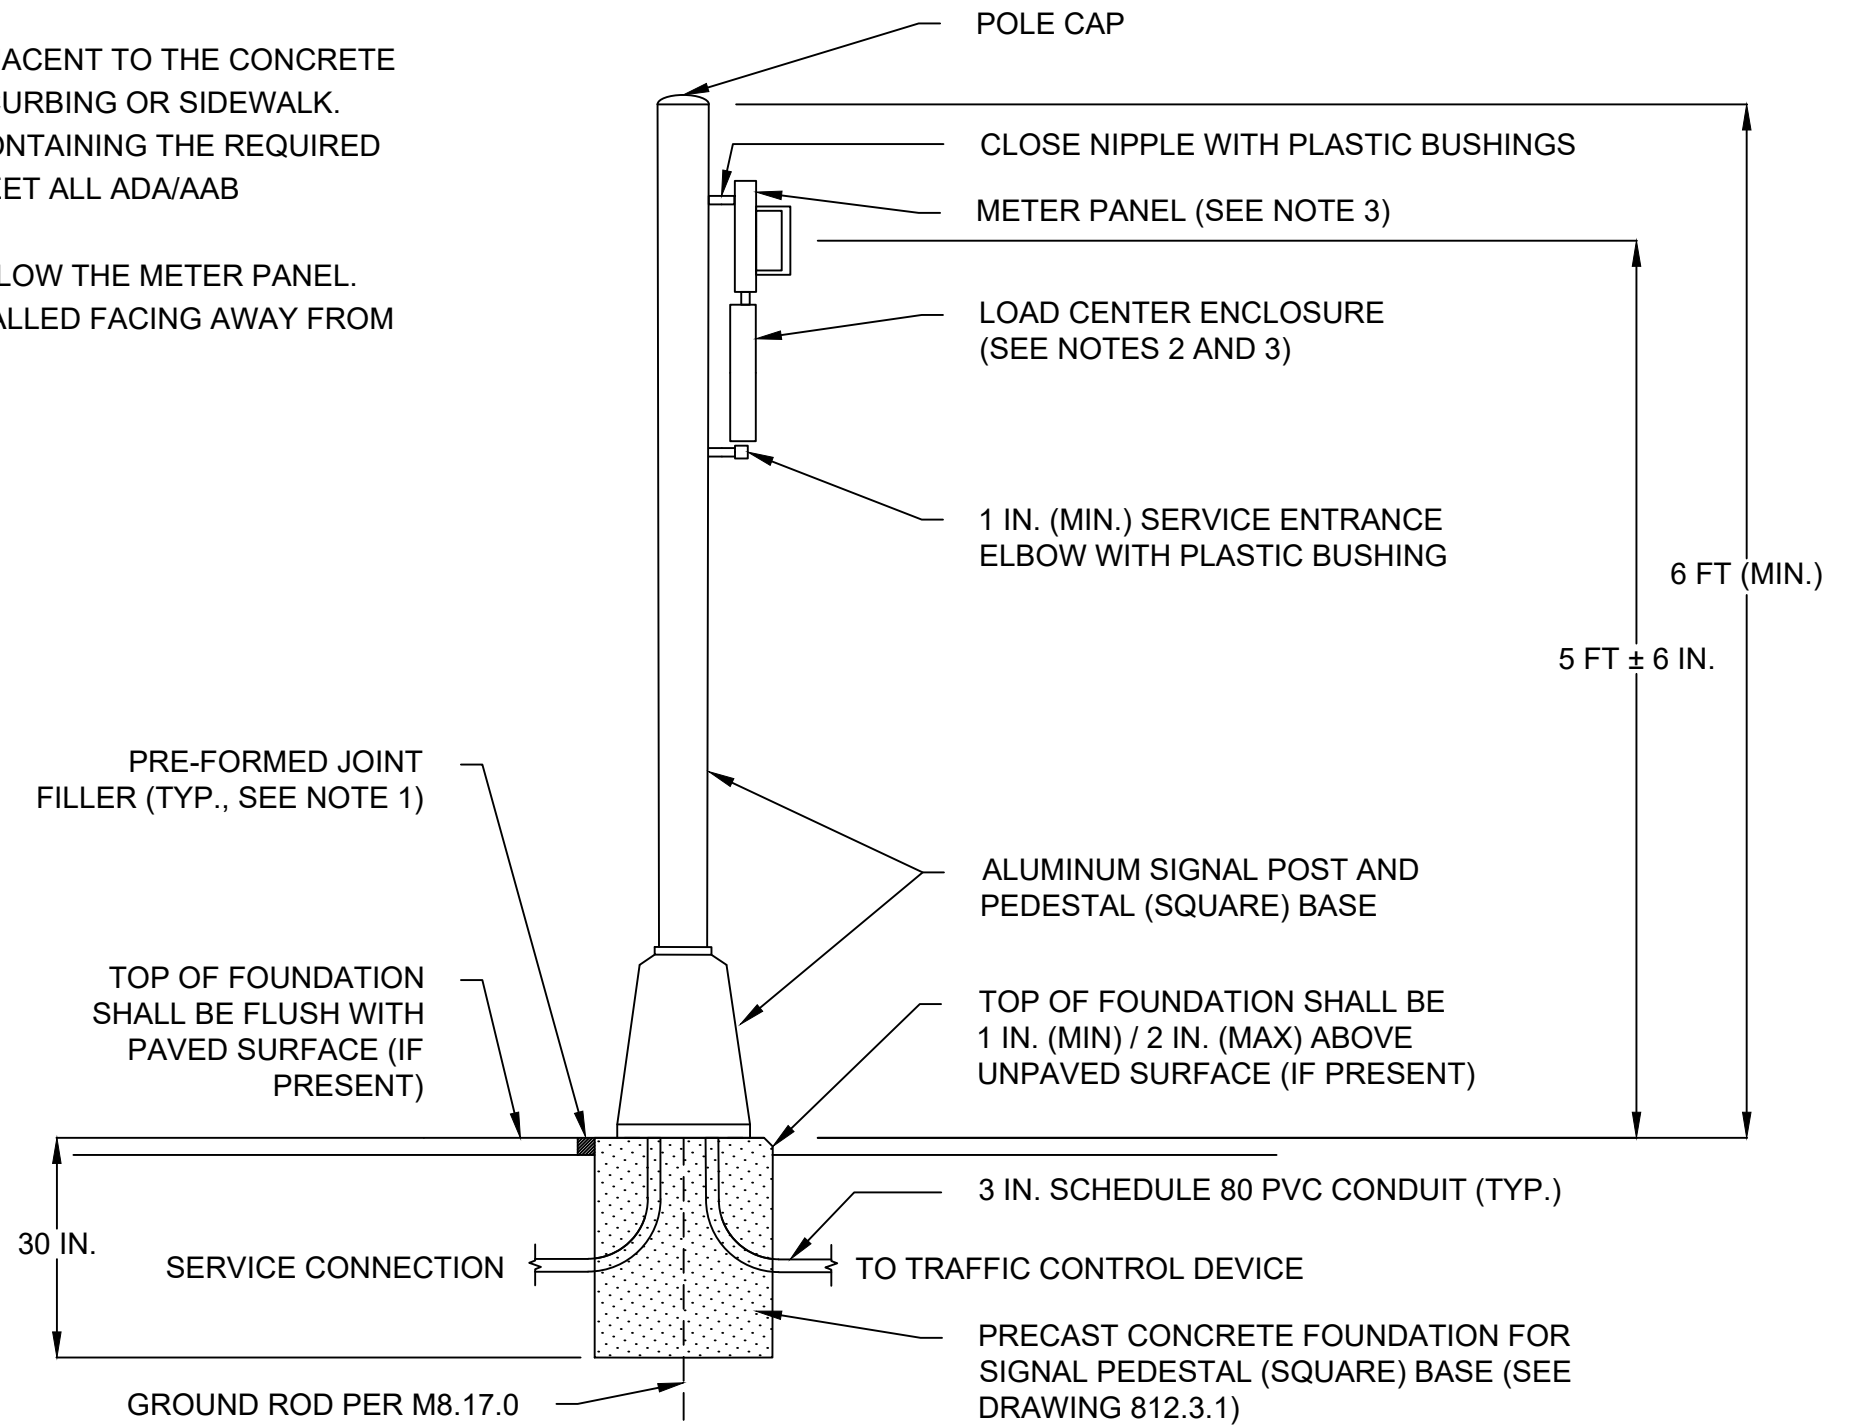

SIDE ELEVATION VIEW